
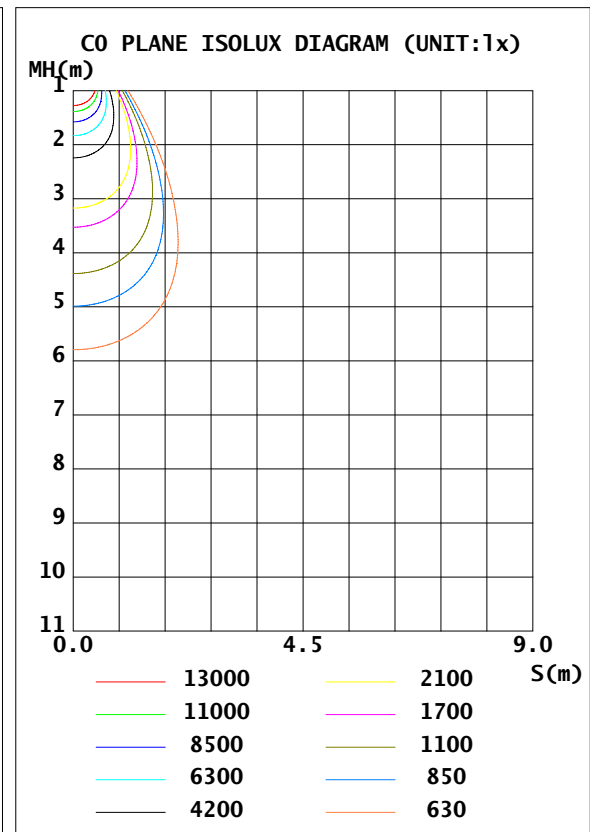


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 1m		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 154.62 lm/W			
MODEL	HB03-150	I _{max} (cd)	20986	S/MH(C0/180)	0.95
NOMINAL POWER(W)	150	LOR(%)	100.0	S/MH(C90/270)	0.95
RATED VOLTAGE(V)	230	TOTAL FLUX(1m)	23268	h UP, DN(C0-180)	0.6, 49.5
NOMINAL FLUX(1m)	23268	CIE CLASS	DIRECT	h UP, DN(C180-360)	0.6, 49.4
LAMPS INSIDE	1	h up(%)	1.1	CIBSE SHR NOM	1.00
TEST VOLTAGE(V)	230	h down(%)	98.9	CIBSE SHR MAX	1.00

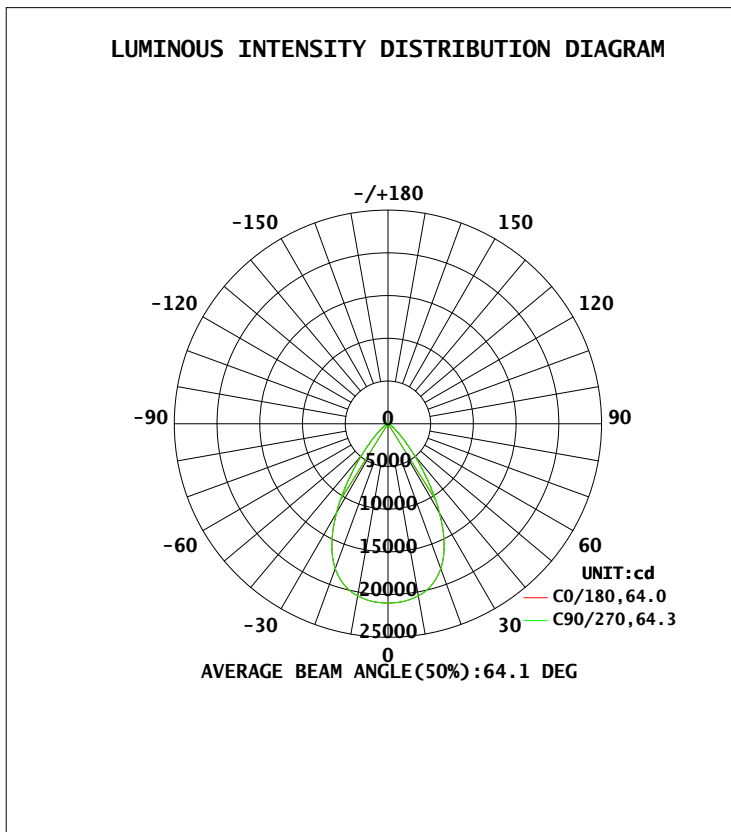

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: ZHANG
 Test Date: 2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity: 65.0%
 Test Distance: 8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

g	C0	C45	C90	C135	C180	C225	C270	C315	g	F zone	F total	%lum,lamp
10	2046	2044	2045	2044	2046	2047	2045	2047	0- 10	1979	1979	8.51,8.51
20	1806	1804	1807	1804	1806	1812	1807	1812	10- 20	5489	7468	32.1,32.1
30	1206	1212	1216	1212	1206	1218	1216	1218	20- 30	7053	14522	62.4,62.4
40	473.7	487.9	487.7	487.9	473.7	481.0	487.7	481.0	30- 40	5133	19654	84.5,84.5
50	136.1	140.2	141.3	140.2	136.1	138.9	141.3	138.9	40- 50	2105	21760	93.5,93.5
60	48.13	48.29	49.03	48.29	48.13	49.59	49.03	49.59	50- 60	750.9	22511	96.7,96.7
70	21.72	21.36	21.77	21.36	21.72	22.23	21.77	22.23	60- 70	327.3	22838	98.2,98.2
80	6.938	6.770	6.932	6.770	6.938	7.059	6.932	7.059	70- 80	148.8	22987	98.8,98.8
90	0.2244	0.2234	0.2251	0.2234	0.2244	0.2262	0.2251	0.2262	80- 90	22.53	23009	98.9,98.9
100	0.4338	0.4380	0.4404	0.4380	0.4338	0.4403	0.4404	0.4403	90-100	3.411	23013	98.9,98.9
110	1.051	1.066	1.072	1.066	1.051	1.066	1.072	1.066	100-110	7.382	23020	98.9,98.9
120	2.439	2.462	2.473	2.462	2.439	2.465	2.473	2.465	110-120	16.70	23037	99,99
130	4.612	4.642	4.655	4.642	4.612	4.647	4.655	4.647	120-130	31.18	23068	99.1,99.1
140	7.206	7.237	7.247	7.237	7.206	7.234	7.247	7.234	130-140	45.60	23114	99.3,99.3
150	9.714	9.738	9.729	9.738	9.714	9.706	9.729	9.706	140-150	53.08	23167	99.6,99.6
160	12.05	12.07	12.04	12.07	12.05	12.01	12.04	12.01	150-160	50.02	23217	99.8,99.8
170	14.35	14.37	14.35	14.37	14.35	14.33	14.35	14.33	160-170	37.11	23254	99.9,99.9
180	15.52	15.54	15.54	15.54	15.52	15.53	15.54	15.53	170-180	14.22	23268	100,100
DEG	LUMINOUS INTENSITY:×10cd								UNIT:lm			

Conical surface Flux(90deg): 20986 lm

%lum = 90.2%
%lamp = 90.2%

Conical surface Flux(120deg): 22511 lm

%lum = 96.7%
%lamp = 96.7%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:ZHANG
Test Date:2015-12-29


g Range: 0 - 180DEG
g Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:8.270m [K=1.0000]
Remarks:

Checker:

Assessor:

LUMINANCE LIMITATION CURVES

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 lm		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

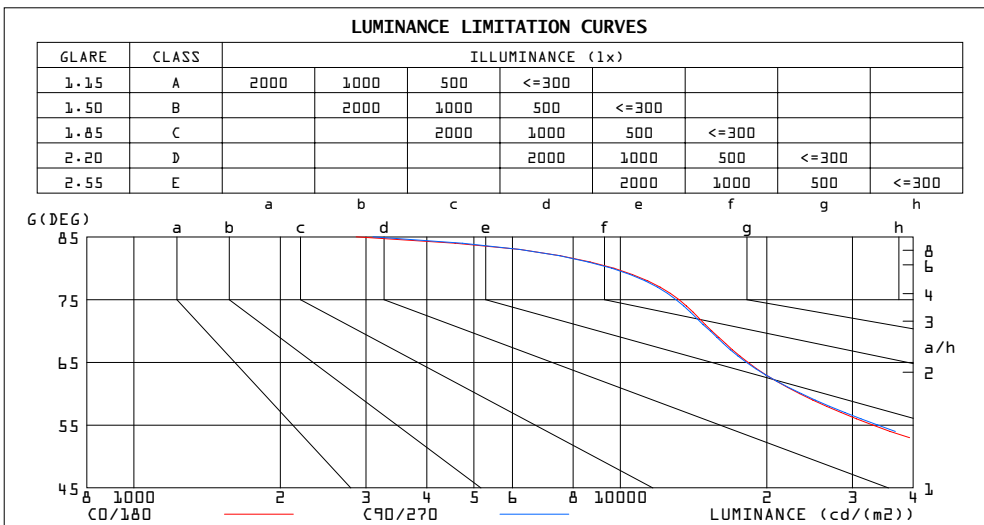

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	2864	3102
80	9700	9598
75	13197	13013
70	15416	15305
65	18289	18154
60	23369	23578
55	33038	33825
50	51402	52853
45	87317	89708

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:


Checker:

Assessor:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 lm		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

rcc	80%			70%			50%			30%			10%			0
	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	rcc	
rcc	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
rcc	20%	20%			20%			20%			20%			0		
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.10	1.10	1.10	1.06	1.06	1.06	1.01	1.01	1.01	.99
1.0	1.10	1.07	1.04	1.07	1.05	1.03	1.03	1.01	.99	.99	.98	.96	.96	.94	.93	.91
2.0	1.01	.97	.93	.99	.95	.92	.96	.92	.90	.93	.90	.88	.90	.87	.86	.84
3.0	.93	.88	.84	.92	.87	.83	.89	.85	.81	.86	.83	.80	.84	.81	.79	.77
4.0	.87	.81	.76	.85	.80	.75	.83	.78	.74	.81	.77	.73	.79	.75	.72	.71
5.0	.80	.74	.69	.79	.73	.69	.77	.72	.68	.76	.71	.68	.74	.70	.67	.65
6.0	.75	.68	.64	.74	.68	.64	.72	.67	.63	.71	.66	.62	.69	.65	.62	.60
7.0	.70	.64	.59	.69	.63	.59	.68	.62	.58	.66	.62	.58	.65	.61	.58	.56
8.0	.66	.59	.55	.65	.59	.55	.64	.58	.54	.63	.58	.54	.61	.57	.54	.52
9.0	.62	.55	.51	.61	.55	.51	.60	.54	.51	.59	.54	.50	.58	.53	.50	.49
10.0	.58	.52	.48	.57	.52	.48	.57	.51	.47	.56	.51	.47	.55	.50	.47	.46

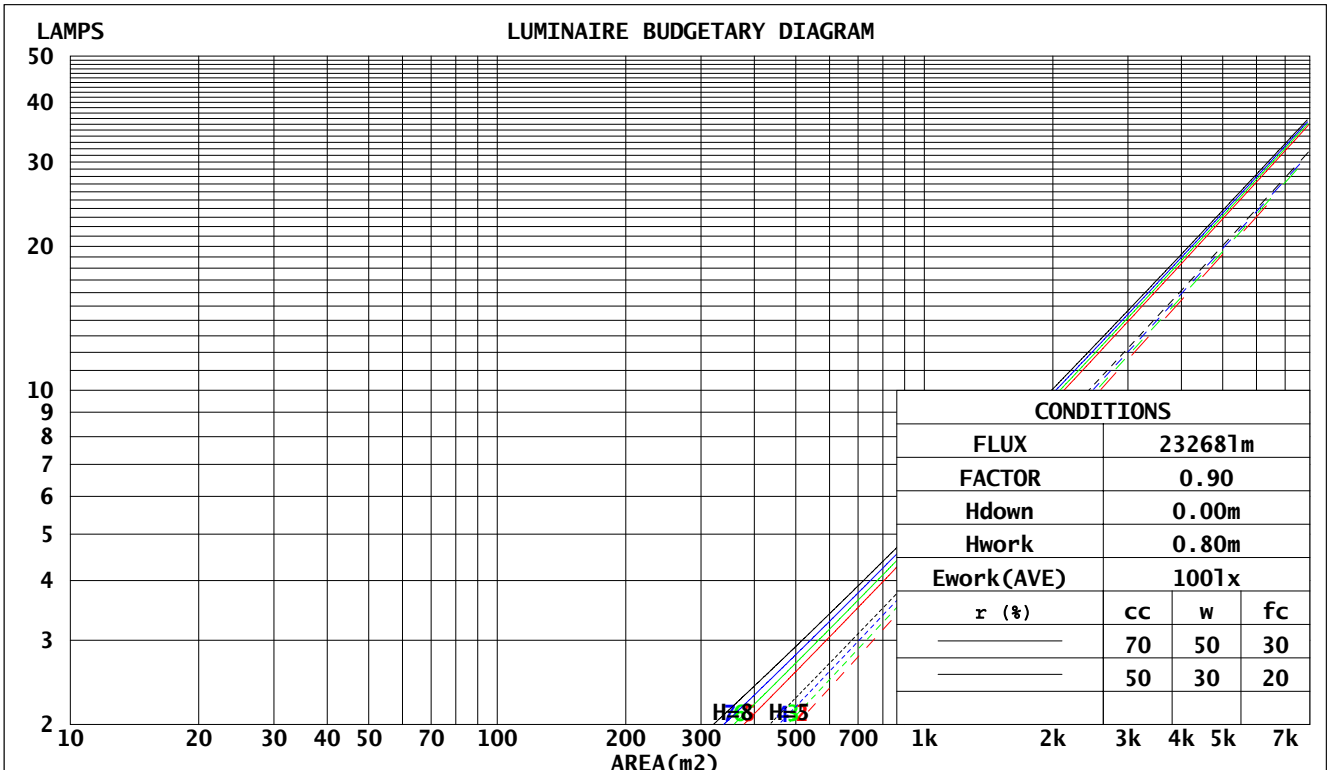

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

WEC AND CCEC

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 1m								
NAME: HB03-150			TYPE:150W			WEIGHT:		
SPEC.:5000K Ra70 60DEG			DIM.: 0.38*0.38*0.12			SERIAL No.:		
MFR.:			SUR.:0.23*0.23			Shielding Angle:		

rCC	80%			70%			50%			30%			10%			0
rW	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
rFC	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.194	.110	.035	.187	.107	.034	.174	.100	.032	.162	.093	.030	.150	.087	.028	
2.0	.187	.102	.031	.181	.100	.031	.170	.094	.029	.159	.089	.028	.150	.085	.027	
3.0	.178	.095	.028	.173	.093	.028	.163	.088	.027	.154	.084	.026	.146	.081	.025	
4.0	.169	.088	.026	.165	.086	.026	.156	.083	.025	.148	.080	.024	.141	.077	.023	
5.0	.161	.082	.024	.157	.081	.023	.150	.078	.023	.143	.075	.022	.136	.073	.022	
6.0	.153	.077	.022	.150	.076	.022	.143	.073	.021	.137	.071	.021	.131	.069	.020	
7.0	.146	.072	.020	.143	.071	.020	.137	.069	.020	.131	.067	.020	.126	.066	.019	
8.0	.139	.068	.019	.137	.067	.019	.131	.066	.019	.126	.064	.018	.121	.062	.018	
9.0	.133	.064	.018	.131	.064	.018	.126	.062	.018	.121	.061	.017	.117	.059	.017	
10.0	.127	.061	.017	.125	.060	.017	.121	.059	.017	.117	.058	.016	.113	.057	.016	

rCC	80%			70%			50%			30%			10%			0
rW	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
rFC	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.199	.199	.199	.170	.170	.170	.116	.116	.116	.067	.067	.067	.021	.021	.021	
1.0	.181	.166	.152	.155	.142	.131	.106	.098	.090	.061	.057	.053	.020	.018	.017	
2.0	.167	.141	.119	.143	.121	.103	.098	.084	.072	.056	.049	.042	.018	.016	.014	
3.0	.155	.122	.096	.133	.106	.083	.091	.073	.058	.053	.043	.034	.017	.014	.011	
4.0	.146	.108	.079	.125	.093	.069	.086	.065	.048	.050	.038	.029	.016	.012	.009	
5.0	.138	.097	.066	.118	.084	.058	.081	.058	.041	.047	.034	.024	.015	.011	.008	
6.0	.131	.087	.057	.112	.076	.049	.077	.053	.035	.045	.031	.021	.014	.010	.007	
7.0	.124	.080	.049	.107	.069	.043	.074	.049	.030	.043	.029	.018	.014	.009	.006	
8.0	.119	.074	.043	.102	.064	.038	.071	.045	.027	.041	.027	.016	.013	.009	.005	
9.0	.114	.069	.039	.098	.060	.034	.068	.042	.024	.039	.025	.014	.013	.008	.005	
10.0	.109	.065	.035	.094	.056	.031	.065	.039	.022	.038	.023	.013	.012	.008	.004	

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

UGR(Unified Glare Rating) Table

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 1m										
NAME: HB03-150					TYPE:150W			WEIGHT:		
SPEC.:5000K Ra70 60DEG					DIM.: 0.38*0.38*0.12			SERIAL No.:		
MFR.:					SUR.:0.23*0.23			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	24.1	25.1	24.3	25.3	25.5	24.1	25.2	24.4	25.4	25.6
3H	24.1	25.0	24.3	25.2	25.5	24.1	25.1	24.4	25.3	25.5
4H	24.0	24.9	24.3	25.2	25.4	24.1	25.0	24.4	25.2	25.5
6H	24.0	24.8	24.3	25.1	25.4	24.0	24.9	24.4	25.1	25.4
8H	24.0	24.8	24.3	25.0	25.3	24.0	24.8	24.3	25.1	25.4
12H	23.9	24.7	24.3	25.0	25.3	24.0	24.7	24.3	25.0	25.3
4H 2H	23.9	24.8	24.2	25.1	25.3	24.0	24.9	24.3	25.1	25.4
3H	24.0	24.7	24.3	25.0	25.3	24.0	24.8	24.3	25.1	25.4
4H	24.0	24.7	24.3	25.0	25.3	24.0	24.7	24.4	25.0	25.4
6H	24.0	24.6	24.4	24.9	25.3	24.0	24.6	24.4	25.0	25.3
8H	23.9	24.5	24.3	24.9	25.3	24.0	24.5	24.4	24.9	25.3
12H	23.9	24.4	24.3	24.8	25.2	23.9	24.4	24.4	24.8	25.2
8H 4H	23.9	24.4	24.3	24.8	25.2	23.9	24.5	24.3	24.9	25.3
6H	23.9	24.4	24.3	24.8	25.2	23.9	24.4	24.4	24.8	25.2
8H	23.9	24.3	24.3	24.7	25.2	23.9	24.3	24.4	24.8	25.2
12H	23.8	24.2	24.3	24.6	25.1	23.9	24.2	24.3	24.7	25.2
12H 4H	23.8	24.4	24.3	24.7	25.2	23.9	24.4	24.3	24.8	25.2
6H	23.8	24.3	24.3	24.7	25.2	23.9	24.3	24.4	24.7	25.2
8H	23.8	24.2	24.3	24.6	25.1	23.9	24.2	24.4	24.7	25.2
Variations with the observer position at spacings:										
S = 1.0H	+ 2.2 / - 4.3					+ 2.2 / - 4.3				
1.5H	+ 3.7 / - 3.6					+ 3.7 / - 3.6				
2.0H	+ 3.9 / - 2.8					+ 4.0 / - 2.9				

CIE Pub.117 Corrected 23268 1m Total Lamp Luminous Flux.(81log(F/F0) = 10.9)

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

UTILIZATION FACTORS TABLE

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 1m		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) k(RI) x RCR = 5									
k = 0.60	82	74	70	81	74	70	80	74	70	66
0.80	90	83	79	89	83	79	88	82	78	74
1.00	95	89	85	94	88	84	93	88	84	79
1.25	100	94	90	99	93	90	97	92	89	84
1.50	103	98	94	102	97	93	99	95	92	87
2.00	106	102	98	105	101	97	102	98	96	90
2.50	108	104	101	107	103	100	103	100	98	91
3.00	110	106	103	108	105	102	105	102	100	93
4.00	112	109	107	110	108	105	106	104	102	95
5.00	114	111	109	112	109	107	107	106	104	96
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29


g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

ISOCANDELA DIAGRAM

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 lm		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

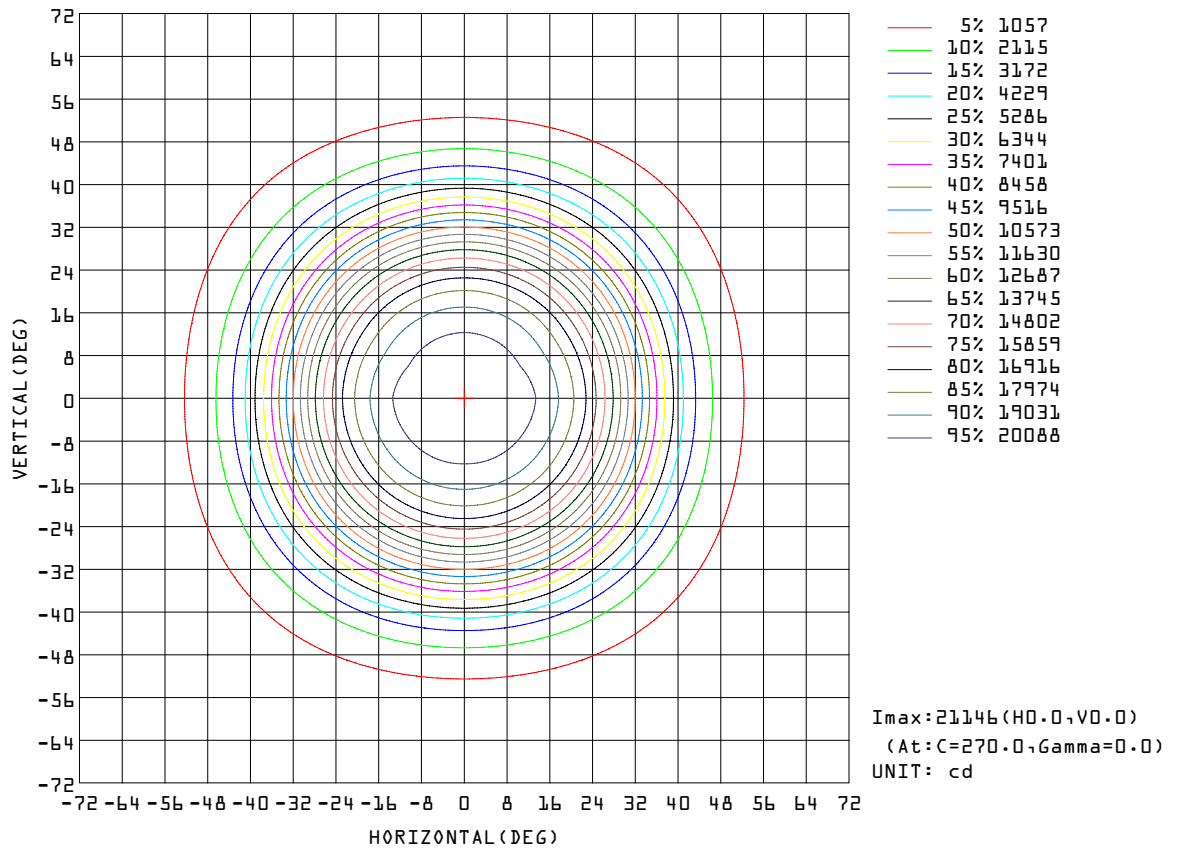

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29


g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

AAI Figure

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 lm		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

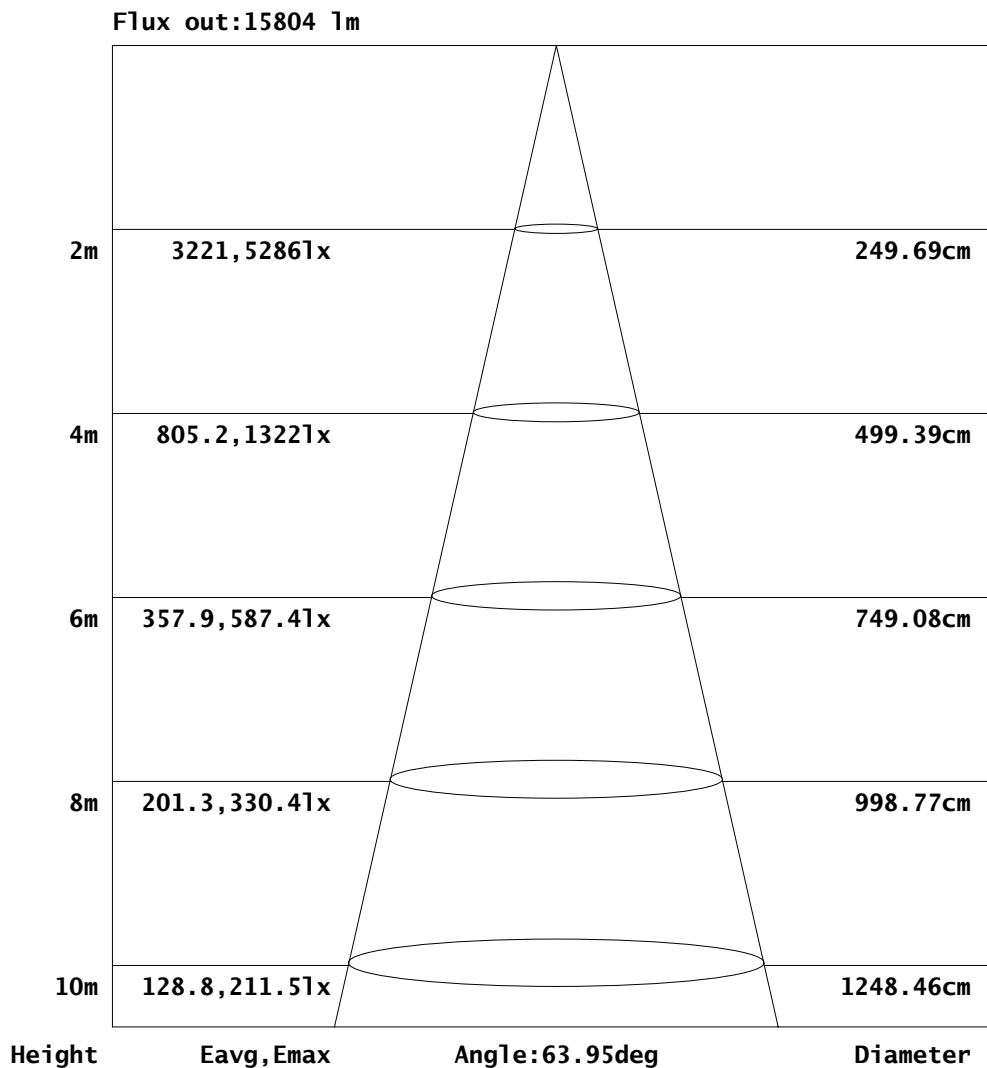

Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: ZHANG
 Test Date: 2015-12-29


g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity: 65.0%
 Test Distance: 8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

ISOLUX DIAGRAM

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 lm		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

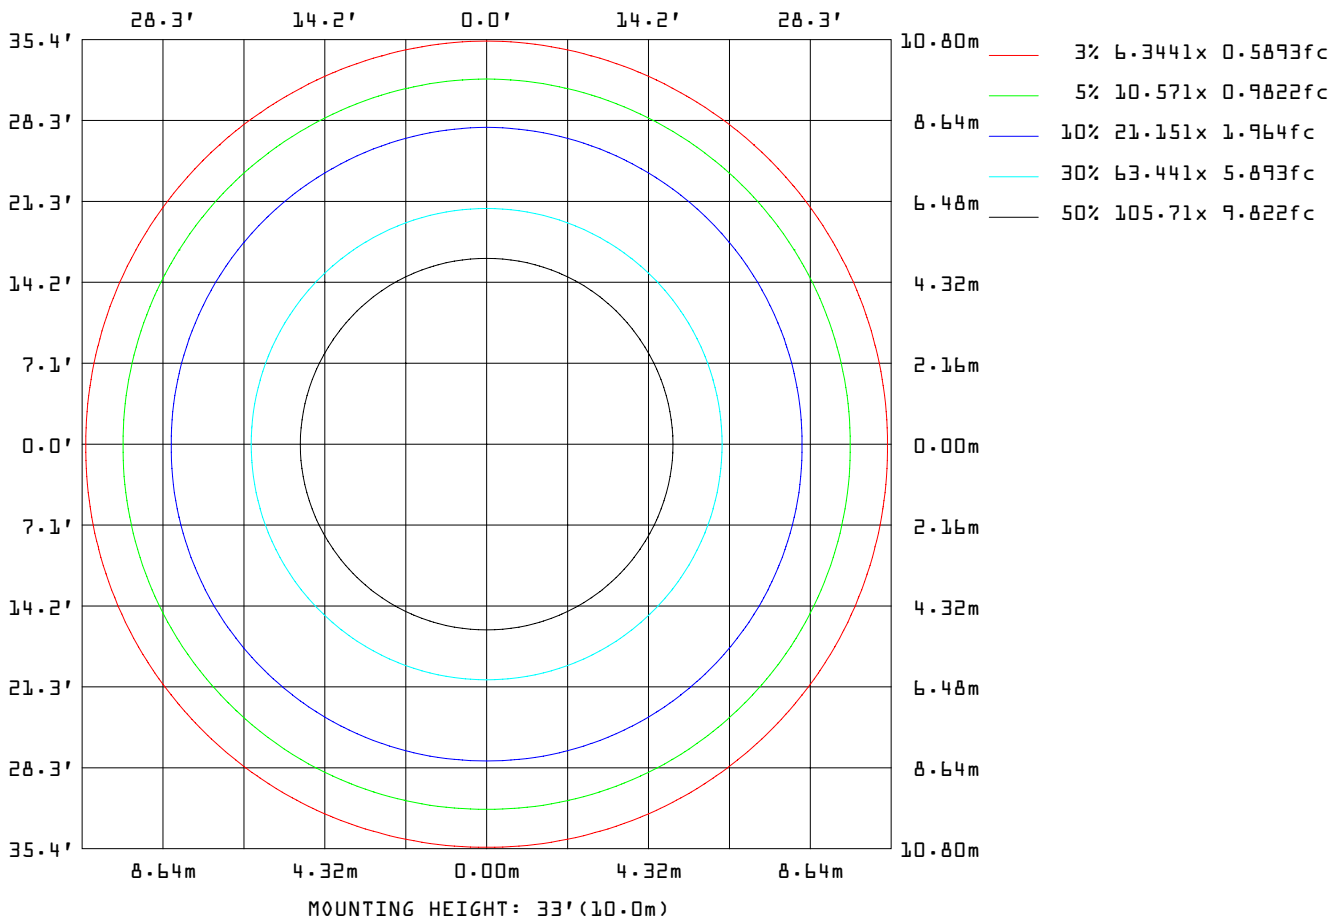


C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

Planar Illuminance Curve

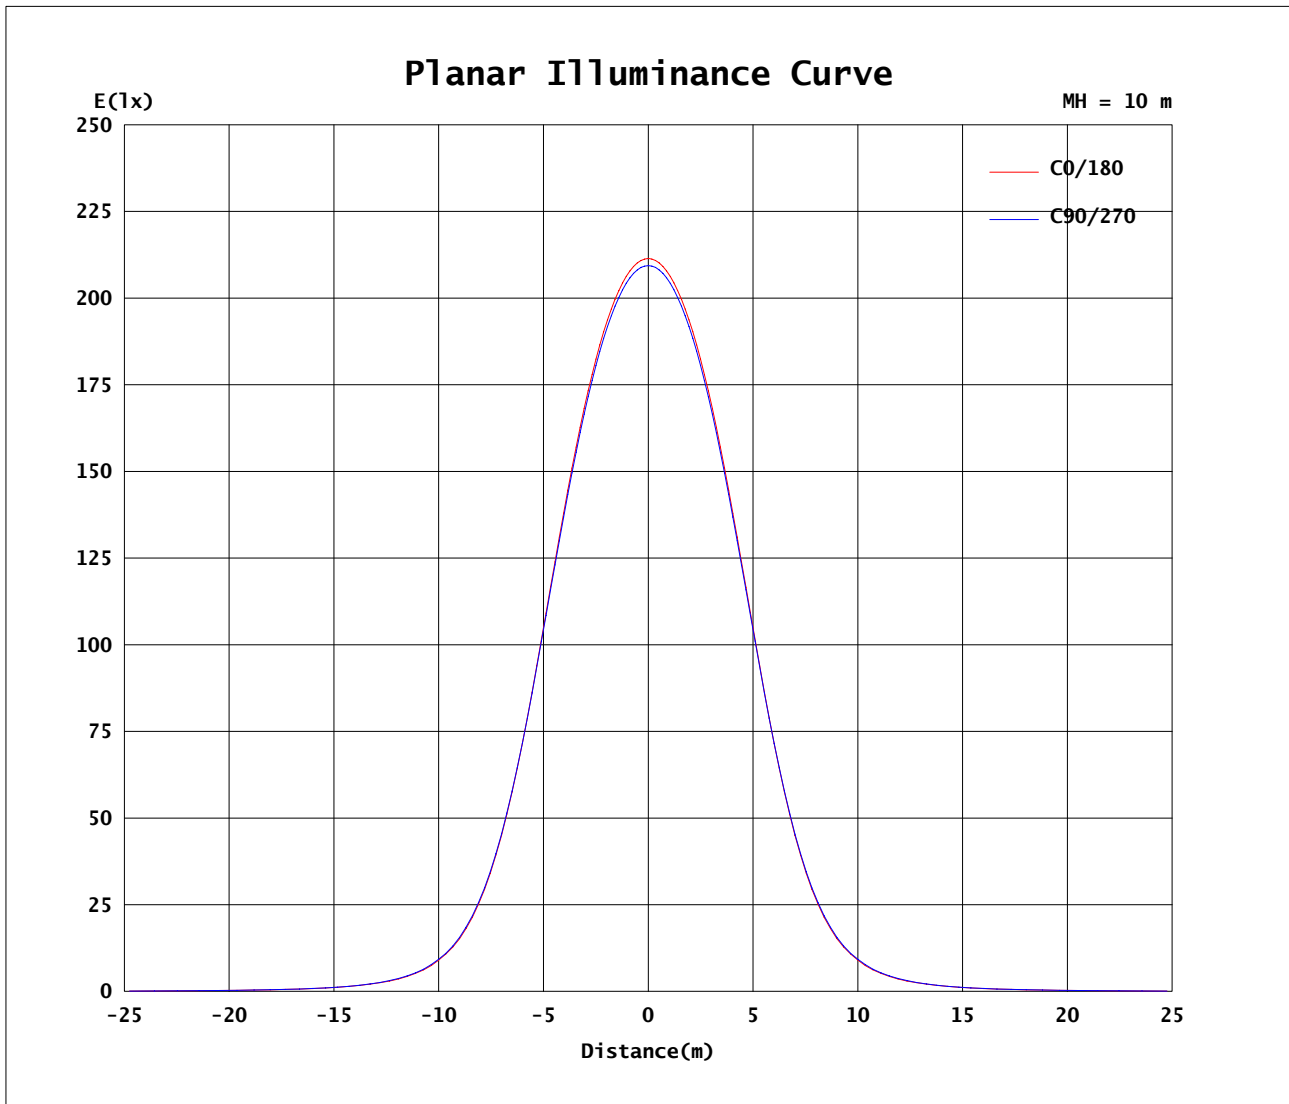

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: ZHANG
 Test Date: 2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity: 65.0%
 Test Distance: 8.270m [K=1.0000]
 Remarks:

Checker:

Assessor:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:230.8V I:0.6726A P:150.5W PF:0.9694 Lamp Flux:23268x1 1m		
NAME: HB03-150	TYPE:150W	WEIGHT:
SPEC.:5000K Ra70 60DEG	DIM.: 0.38*0.38*0.12	SERIAL No.:
MFR.:	SUR.:0.23*0.23	Shielding Angle:

Table--1

UNIT: ×10cd

C(DEG)\g (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	2099	2099	2099	2099	2099	2099	2099	2099	2099	2099	2099	2099						
5	2087	2087	2087	2087	2087	2087	2087	2088	2088	2087	2088	2088						
10	2046	2044	2045	2045	2045	2044	2046	2047	2047	2045	2047	2047						
15	1960	1958	1958	1960	1958	1958	1960	1963	1964	1960	1964	1963						
20	1806	1804	1804	1807	1804	1804	1806	1812	1811	1807	1811	1812						
25	1555	1555	1558	1560	1558	1555	1555	1564	1564	1560	1564	1564						
30	1206	1210	1214	1216	1214	1210	1206	1218	1218	1216	1218	1218						
35	813	824	828	828	828	824	813	825	826	828	826	825						
40	474	486	490	488	490	486	474	480	482	488	482	480						
45	254	262	263	264	263	262	254	258	256	264	256	258						
50	136	139	141	141	141	139	136	138	139	141	139	138						
55	78.0	78.6	80.0	80.7	80.0	78.6	78.0	79.9	80.7	80.7	80.7	79.9						
60	48.1	48.0	48.6	49.0	48.6	48.0	48.1	49.3	49.9	49.0	49.9	49.3						
65	31.8	31.4	31.7	31.9	31.7	31.4	31.8	32.5	32.8	31.9	32.8	32.5						
70	21.7	21.3	21.4	21.8	21.4	21.3	21.7	22.1	22.3	21.8	22.3	22.1						
75	14.1	13.7	13.8	14.0	13.8	13.7	14.1	14.3	14.4	14.0	14.4	14.3						
80	6.94	6.78	6.76	6.93	6.76	6.78	6.94	7.02	7.09	6.93	7.09	7.02						
85	1.03	1.02	1.04	1.12	1.04	1.02	1.03	1.02	1.08	1.12	1.08	1.02						
90	0.22	0.22	0.22	0.23	0.22	0.22	0.22	0.23	0.23	0.23	0.23	0.23						
95	0.30	0.30	0.30	0.30	0.30	0.30	0.30	0.30	0.31	0.30	0.31	0.30						
100	0.43	0.44	0.44	0.44	0.44	0.44	0.43	0.44	0.44	0.44	0.44	0.44						
105	0.67	0.67	0.68	0.68	0.68	0.67	0.67	0.67	0.67	0.68	0.67	0.67						
110	1.05	1.06	1.07	1.07	1.07	1.06	1.05	1.07	1.07	1.07	1.07	1.07						
115	1.64	1.65	1.66	1.66	1.66	1.65	1.64	1.66	1.66	1.66	1.66	1.66						
120	2.44	2.46	2.47	2.47	2.47	2.46	2.44	2.47	2.46	2.47	2.46	2.47						
125	3.44	3.46	3.48	3.48	3.48	3.46	3.44	3.47	3.47	3.48	3.47	3.47						
130	4.61	4.63	4.65	4.65	4.65	4.63	4.61	4.64	4.65	4.65	4.65	4.64						
135	5.89	5.91	5.93	5.94	5.93	5.91	5.89	5.92	5.92	5.94	5.92	5.92						
140	7.21	7.23	7.24	7.25	7.24	7.23	7.21	7.23	7.24	7.25	7.24	7.23						
145	8.49	8.52	8.53	8.52	8.53	8.52	8.49	8.50	8.51	8.52	8.51	8.50						
150	9.71	9.74	9.74	9.73	9.74	9.74	9.71	9.70	9.71	9.73	9.71	9.70						
155	10.9	10.9	10.9	10.9	10.9	10.9	10.9	10.8	10.9	10.9	10.9	10.8						
160	12.0	12.1	12.1	12.0	12.1	12.1	12.0	12.0	12.0	12.0	12.0	12.0						
165	13.2	13.3	13.2	13.2	13.2	13.3	13.2	13.2	13.2	13.2	13.2	13.2						
170	14.3	14.4	14.4	14.4	14.4	14.4	14.3	14.3	14.3	14.4	14.3	14.3						
175	15.2	15.2	15.2	15.2	15.2	15.2	15.2	15.2	15.2	15.2	15.2	15.2						
180	15.5	15.5	15.5	15.5	15.5	15.5	15.5	15.5	15.5	15.5	15.5	15.5						

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:ZHANG
 Test Date:2015-12-29

g Range: 0 - 180DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity:65.0%
 Test Distance:8.270m [K=1.0000]
 Remarks:

Checker:

Assessor: